

DigiSense

DT Digital Detectors

Models: Digi-415DT
Digi-415DTQ



RISCO
GROUP
Creating Security Solutions
With Care.
riscogroup.com

© RISCO Group 10/2011

5IN1542 B

RTTE Compliance Statement

Risco Ltd. hereby declares that this equipment is in compliance with the essential requirements and other relevant provisions of Directive 1999/5/EC. For the EC Declaration of Conformity please refer to our website: www.riscogroup.com



EN 50131-1 Grade 2
EN 50131-2-4
Grade 3
Environmental Class II

Digi-415DT & Digi-415DTQ applicable countries (European version):

AT	BE	CY	CZ	DK
EE	FI	FR	DE	GR
HU	IE	IT	LV	LT
LU	MT	NL	PL	PT
SE	SL	ES	SK	GB
BG	RO	TR	CH	NO

Digi-415DT & Digi-415DTQ applicable countries (German Version):

AT, CZ, SL, DE, TR, RU, EE

DigiSense FCC compliance Section (US version):

FCC Part 15 Note:


This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment to an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician.


FCC Warning:

The manufacturer is not responsible for any radio or TV interference caused by unauthorized modifications to this equipment. Such modifications could void the user's authority to operate the equipment.


All rights reserved. No part of this document may be reproduced in any form without prior written permission from the publisher.

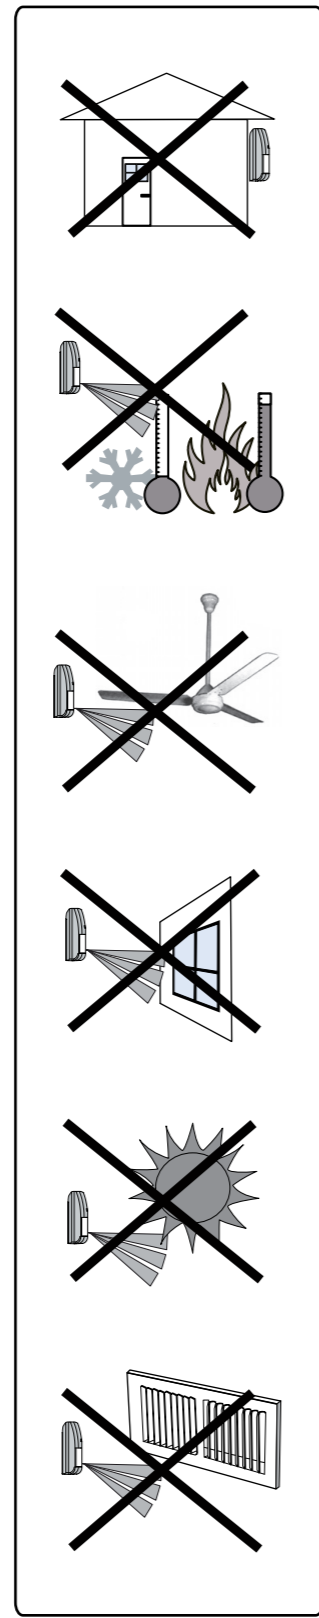


1

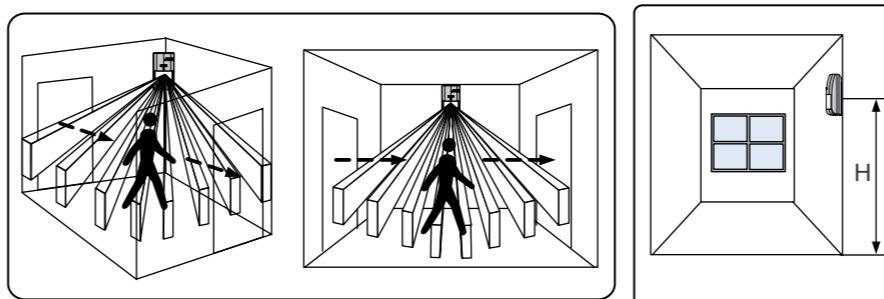

EN	Model / Lens	Wide angle (H)	Corridor (LLPL02) (H)	Curtain (LLPL03) (H)
FR	Numéro de Modèle	Lentille grand angle	Lentille couloir (LLPL02)	Lentille rideau (LLPL03)
SP	Referencia / Modelo	Lente gran angular	Lente de corredor (LLPL02)	Lente cortina (LLPL03)
IT	Codice prodotto	Lenti grandangolo	Lenti corridoio (LLPL02)	Lenti a tenda (LLPL03)
PR	Códigos	Lente de ângulo aberto	Lente de corredor (LLPL02)	Lente de cortina (LLPL03)
PL	Symbol / Model	Soczewka szerokokątna	Soczewka korytarzowa (LLPL02)	Soczewka kurtynowa (LLPL03)
	Digi-415DT	2m-2.7m (6'7"-8'10")	2.5m (8'2.4")	1.5m (Typical)
	Digi-415DTQ	2m-2.7m (6'7"-8'10")	2.5m (8'2.4")	1.5m (Typical)

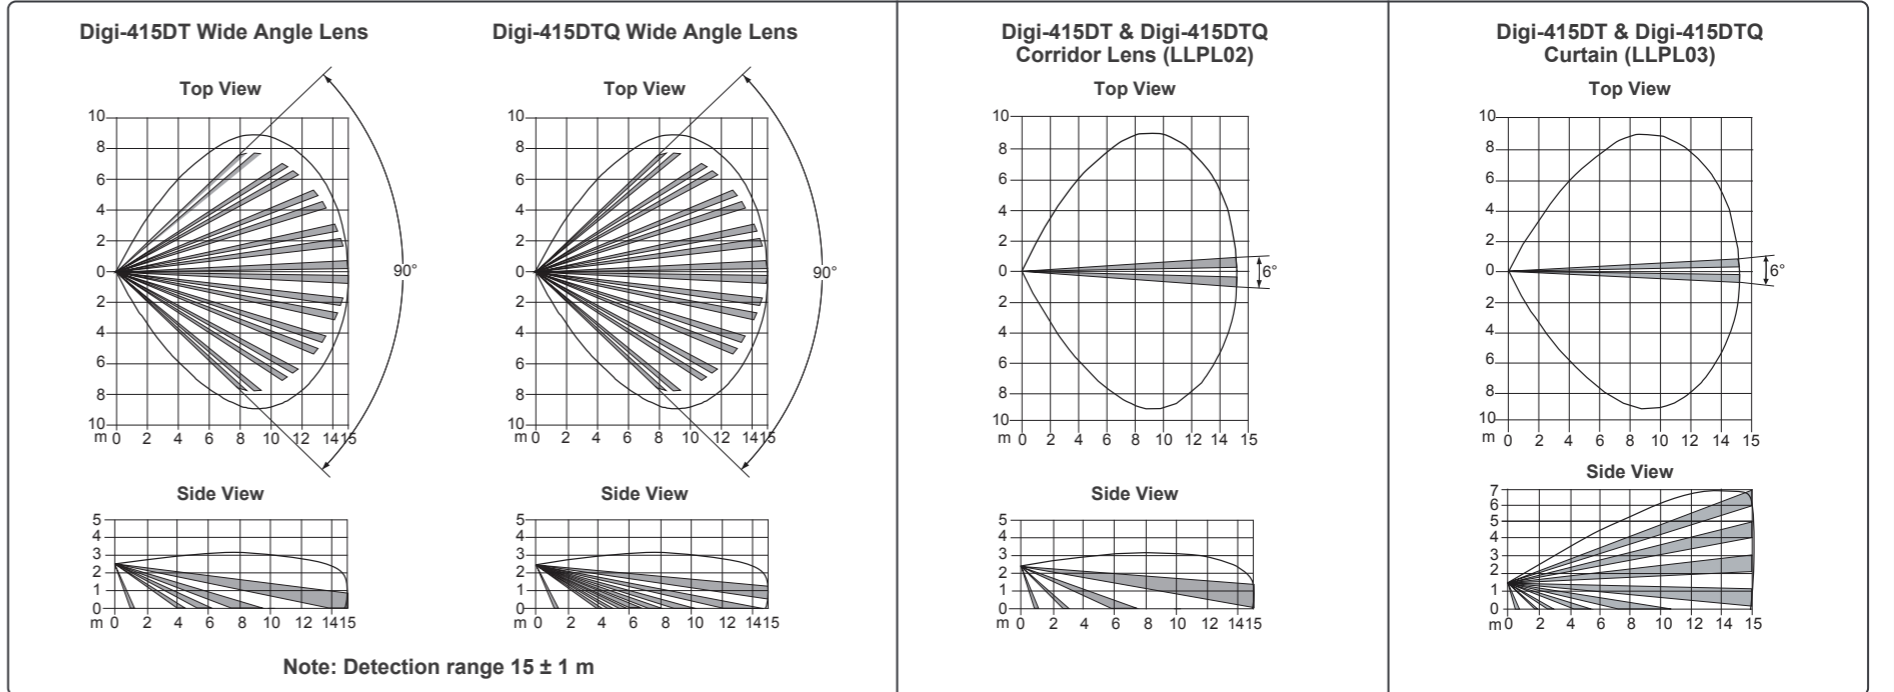

2 Mounting

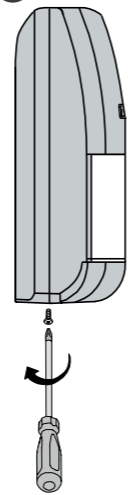


	1	2
EN	Wall mounting	Corner mounting
FR	Montage mural	Montage en coin
SP	Montaje en pared	Montaje en rincón
IT	Montaggio su parete piana	Montaggio ad angolo
PR	Montagem na parede	Montagem no canto
PL	Mocowanie do ściany	Mocowanie narożnym

3 Terminal Wiring

EN	Terminal Connection <ul style="list-style-type: none"> 12VDC: Power supply inputs ALARM: NC Dry Contact switch TAMPER: NC Dry Contact switch 	IT	Collegamento dei Morsetti <ul style="list-style-type: none"> 12VDC: Ingresso alimentazione ALARM: Relè d'allarme NC libero da tensione TAMPER: Relè di tamper NC libero da tensione
FR	Connexion <ul style="list-style-type: none"> 12VDC: alimentation électrique ALARM: contact sec NF d'alarme TAMPER: contact sec NF d'autoprotection 	PR	Terminais de Conexão <ul style="list-style-type: none"> 12VDC: Entrada de alimentação ALARM: Relé de contato seco NF TAMPER: Relé de contato seco NF
SP	Bornes de Conexión <ul style="list-style-type: none"> 12VDC: Entrada de alimentación ALARM: Relé de Contacto Seco N.C. TAMPER: Relé de Contacto Seco N.C. 	PL	Podłączenie <ul style="list-style-type: none"> 12VDC: Zasilanie czujki ALARM: Zaciski alarmowe NC TAMPER: Zaciski sabotazowe NC

4 DIP Switch & Jumper Settings



SW1-1: Pulse 1/2			
	ON	OFF	Important
EN	1 pulse	2 pulses	For corridor and curtain lens use only 1 pulse.
FR	1 impulsion	2 impulsions	Pour les lentilles rideau et couloir, n'utilisez qu'une impulsion.
SP	1 pulso	2 pulsos	Para la lente de pasillo o cortina usar sólo 1 pulso.
IT	1 impulso	2 impulsi	Per le lenti a tenda o corridoio utilizzare solo 1 impulso.
PR	1 pulso	2 pulso	Para lente de corredor, use apenas o pulso 1.
PL	1 impuls	2 impulsów	Ważne: Dla soczewki korytarzowej i kurtynowej licznik impulsów należy ustawić w pozycji ON (1 impuls).

SW1-2: LED ON/OFF		
	ON	OFF
EN	LED Enable	LED Disable
FR	LED Activée	LED Désactivée
SP	LED Activado	LED Desactivado
IT	LED Attivato	LED Disattivato
PR	LED Ativado	LED Desativado
PL	LED Aktywna	LED Wyłączona

5 Schematic of EOL Resistors

